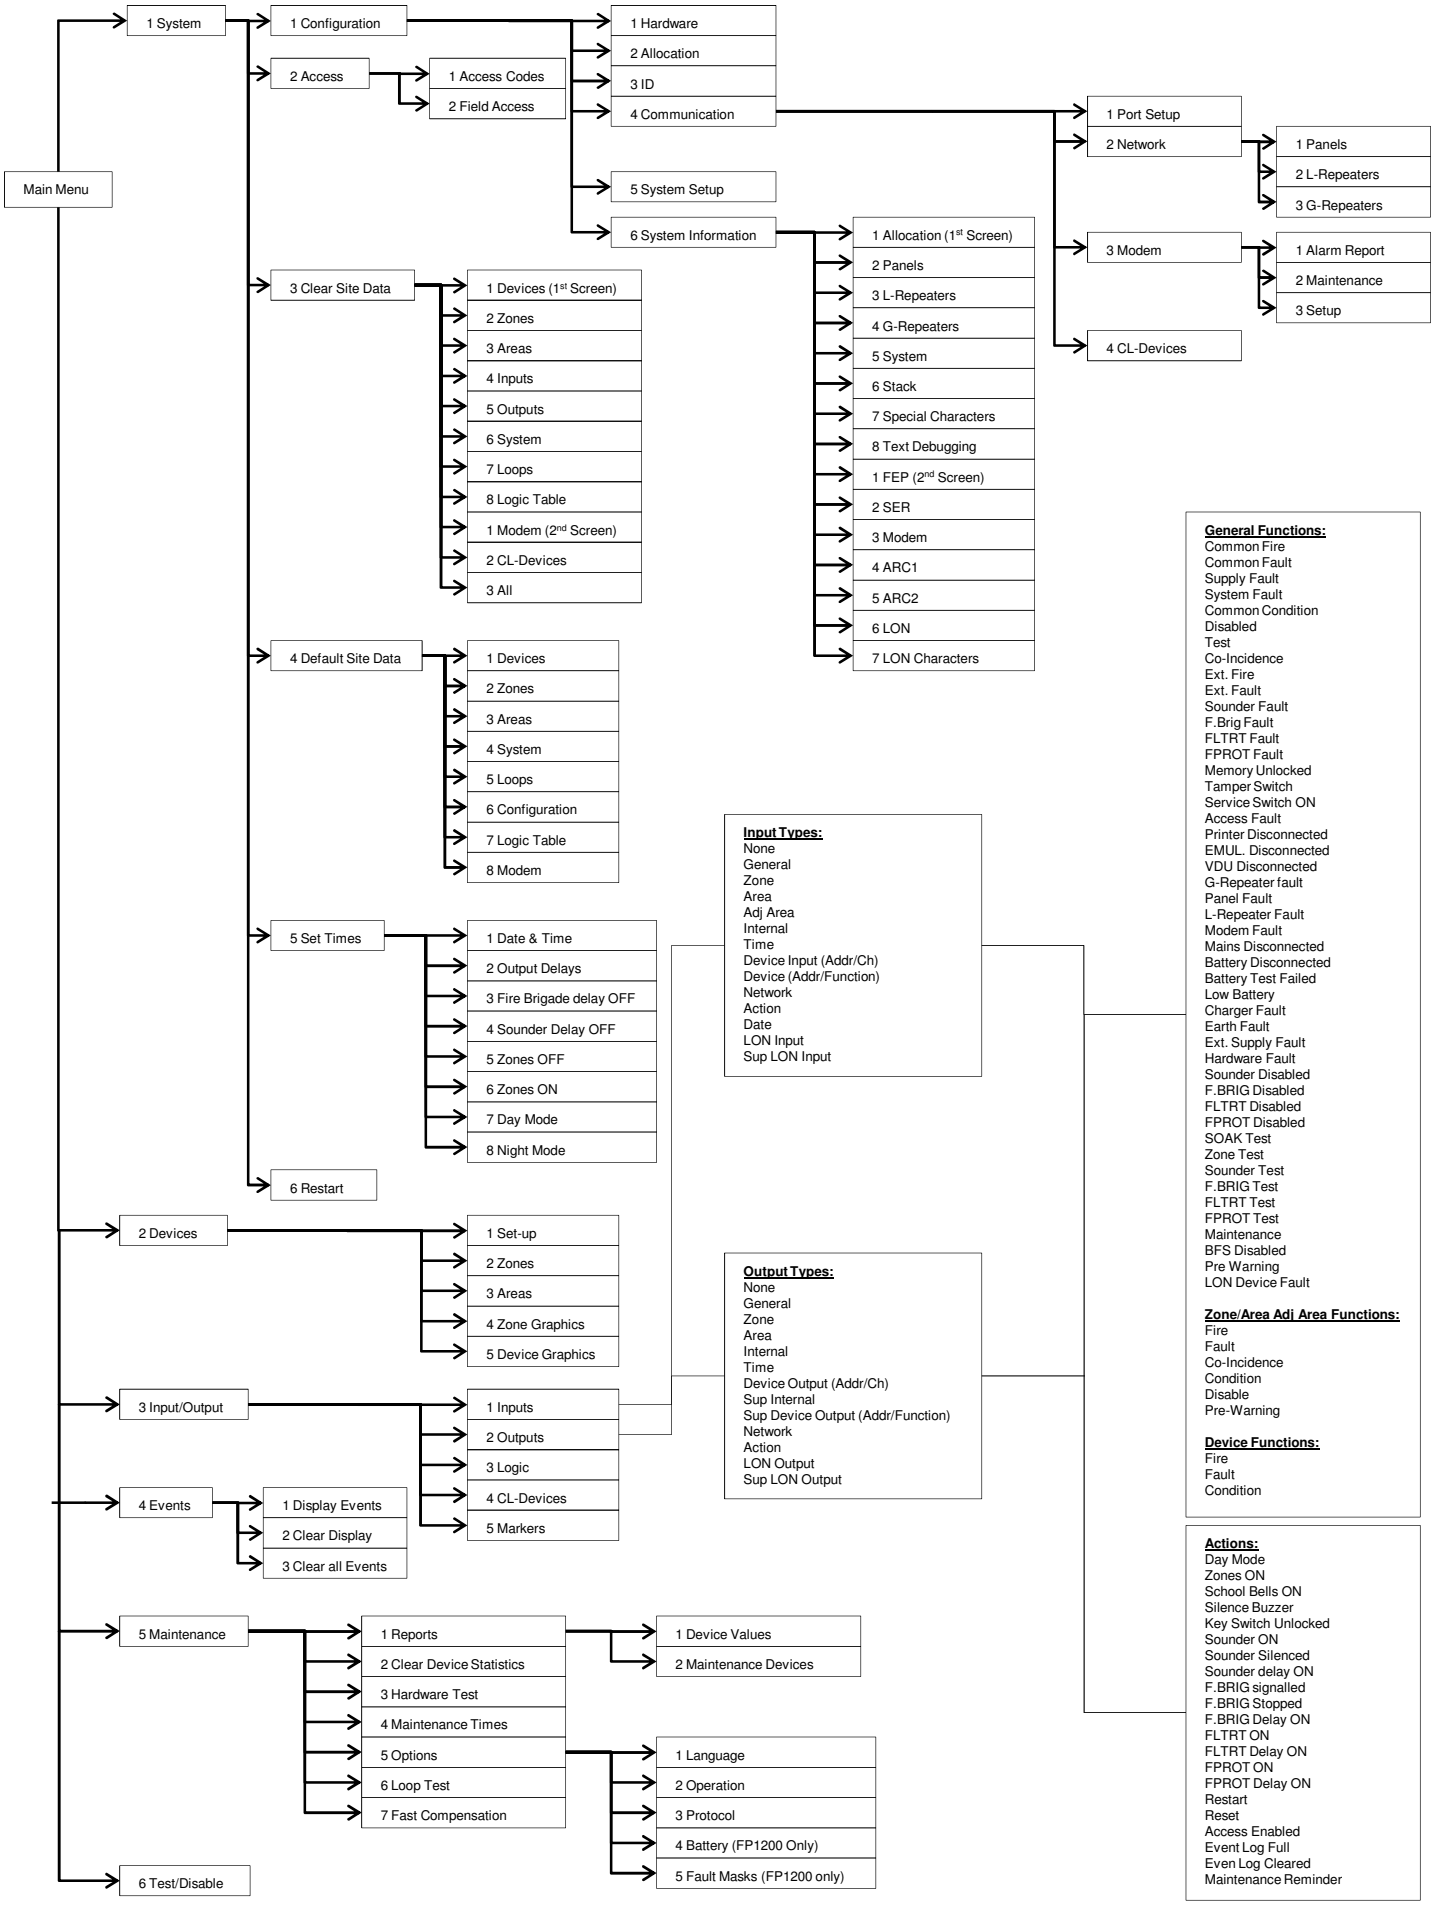
Main Menu
1 System
1 Configuration
1 Hardware
2 Allocation
3 ID
4 Communication
1 Port Setup
2 Network
1 Panels
2 L-Repeaters
3 G-Repeaters
3 Modem
1 Alarm Report
2 Maintenance
3 Setup
4 CL-Devices
5 System Setup
6 System Information
1 Allocation (1st Screen)
2 Panels
3 L-Repeaters
4 G-Repeaters
5 System
6 Stack
7 Special Characters
8 Text Debugging
1 FEP (2nd Screen)
2 SER
3 Modem
4 ARC1
5 ARC2
6 LON
7 LON Characters
2 Access
1 Access Codes
2 Field Access
3 Clear Site Data
1 Devices (1st Screen)
2 Zones
3 Areas
4 Inputs
5 Outputs
6 System
7 Loops
8 Logic Table
1 Modem (2nd Screen)
2 CL-Devices
3 All
4 Default Site Data
1 Devices
2 Zones
3 Areas
4 System
5 Loops
6 Configuration
7 Logic Table
8 Modem
5 Set Times
1 Date & Time
2 Output Delays
3 Fire Brigade delay OFF
4 Sounder Delay OFF
5 Zones OFF
6 Zones ON
7 Day Mode
8 Night Mode
6 Restart
2 Devices
1 Set-up
2 Zones
3 Areas
4 Zone Graphics
5 Device Graphics
3 Input/Output
1 Inputs
2 Outputs
3 Logic
4 CL-Devices
5 Markers
4 Events
1 Display Events
2 Clear Display
3 Clear all Events
5 Maintenance
1 Reports
2 Clear Device Statistics
3 Hardware Test
4 Maintenance Times
5 Options
6 Loop Test
7 Fast Compensation
1 Device Values
2 Maintenance Devices
1 Language
2 Operation
3 Protocol
4 Battery (FP1200 Only)
5 Fault Masks (FP1200 only)
6 Test/Disable
Input Types:
None
General
Zone
Area
Adj Area
Internal
Time
Device Input (Addr/Ch)
Device (Addr/Function)
Network
Action
Date
LON Input
Sup LON Input
Output Types:
None
General
Zone
Area
Internal
Time
Device Output (Addr/Ch)
Sup Internal
Sup Device Output (Addr/Function)
Network
Action
LON Output
Sup LON Output
General Functions:
Common Fire
Common Fault
Supply Fault
System Fault
Common Condition
Disabled
Test
Co-Incidence
Ext. Fire
Ext. Fault
Sounder Fault
F.Brig Fault
FLTRT Fault
FPROT Fault
Memory Unlocked
Tamper Switch
Service Switch ON
Access Fault
Printer Disconnected
EMUL. Disconnected
VDU Disconnected
G-Repeater fault
Panel Fault
L-Repeater Fault
Modem Fault
Mains Disconnected
Battery Disconnected
Battery Test Failed
Low Battery
Charger Fault
Earth Fault
Ext. Supply Fault
Hardware Fault
Sounder Disabled
F.BRIG Disabled
FLTRT Disabled
FPROT Disabled
SOAK Test
Zone Test
Sounder Test
F.BRIG Test
FLTRT Test
FPROT Test
Maintenance
BFS Disabled
Pre Warning
LON Device Fault
Zone/Area Adj Area Functions:
Fire
Fault
Co-Incidence
Condition
Disable
Pre-Warning
Device Functions:
Fire
Fault
Condition
Actions:
Day Mode
Zones ON
School Bells ON
Silence Buzzer
Key Switch Unlocked
Sounder ON
Sounder Silenced
Sounder delay ON
F.BRIG signalled
F.BRIG Stopped
F.BRIG Delay ON
FLTRT ON
FLTRT Delay ON
FPROT ON
FPROT Delay ON
Restart
Reset
Access Enabled
Event Log Full
Even Log Cleared
Maintenance Reminder